TECHNICAL SPECIFICATIONS

Quality

: S-280

Yarn Fiber

: 100% Nylon Solution Dyed

Gauge and Structure : 1/12" Multi-Level Loop Machine Tufted

Size

: 50cm x 50cm

Packing

: 20pcs./box (5m²)

Pile Weight

 ± 20 oz./yd² (680g/m²)

Total Weight

: ± 4,800g./m²

Pile Height

: ± 3.5 / 4.0 / 4.5mm

Total Height

: ± 7.5mm

Primary Backing

: 100% Spun Bonded Polyester (Non-Woven)

Secondary Backing

: PVC with Glass Fiber

Critical Radiant Flux : ASTM E648-2019 / NFPA 101-2018

Smoke Density

: ASTM E662-2018

Fire Classification

: EN 13501-1: 2007+A1:2009 B_{fl}

Colorfastness

: AATCC TM 165-2013

Tuft Bind of Pile : ASTM D 1335-17E1

Environmental Cert. : C R I Green Label Plus GLP100054

Quality Management : ISO-9001:2000 / ISO-14001:2004



No. AJFS2009008018FF

Date: OCT.16, 2020

Page 2 of 4

I. Test conducted

This test was conducted in accordance with ASTM E 648-2019 Standard test method for critical radiant flux of floor-covering systems using a radiant heat energy source.

II. Sample details

| Sample description | Carpet Tile | |
|--------------------|--|-------|
| Color | Multi | |
| Exposed surface | The front surface | |
| Specimen size | Length: 1050mm; Width: 250mm; Thickness: 5.5mm | 3 PCS |

| Precondition Temperature: 21±3°C, Humidity: 50±5%, Duration: 9 days | Precondition | Temperature: 21±3℃, | Humidity: 50±5%, | Duration: 9 days | |
|---|--------------|---------------------|------------------|------------------|--|
|---|--------------|---------------------|------------------|------------------|--|

III. Test results

| Distance (mm) | S1 | S2 | S3 |
|----------------------|-----------------------|-----------------------|-----------------------|
| Distance (min) | Time (minute: second) | Time (minute: second) | Time (minute: second) |
| 50 | 5:48 | 6:01 | 5:51 |
| 100 | 9:23 | 10:12 | 10:26 |
| 150 | - | | 9# |
| 200 | - | •) | S = |
| 250 | - | | - |
| 300 | | | |
| 350 | - | - | |
| 400 | - | - | |
| 450 | - | - | 5 = |
| 500 | - | - | - |
| 550 | ₩) | - | - |
| 600 | - | - | |
| 650 | - | <u> </u> | |
| 700 | • | | |
| 750 | - | % <u>-</u> | # |
| 800 | - | (= | • |
| 850 | - | - | * |
| 900 | - | | - |
| 950 | - | : <u>-</u> | - |
| 1000 | " | | #. V |
| 1050 | - | - | - |
| Extinguishing time | 13:16 | 14:19 | 12:43 |
| Burned distance (mm) | 120 | 130 | 120 |

To be continued...



Inters otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printseprevietal, available on request or accessible at http://www.sas.com/nritems-and-conditions.aspg and, for electronic format documents subject to Terms and Conditions for Electronic Documents at http://www.sas.com/nriterms-and-conditions/ferms-a-Document.aspx filtention is drawn to the limitation of liability, indemnification and jurisdiction is usual defined them. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits or Jiens's instructions, if any. The Company's sofe responsibility is to its Client and this document does not exonerate parties to it vanished to the contained of the contained of



Test Report No. AJFS2009008018FF Date: OCT.16, 2020 Page 3 of 4 S1 S2 S3 Average S V Critical radiant flux (W/cm2) 1.1 1.1 1.1 1.1 0 0

Remark:

S-standard deviation; V-coefficient of variation

<u>Classification</u>: NFPA 101-2018 Life Safety Code Chapter 10 Interior Finish, Contents, and Furnishings Clause 10.2.7.4 Interior Floor Finish Test and Classification,

- (1) Class I interior floor finish shall be characterized by a critical radiant flux not less than 0.45 W/cm².
- (2) Class II interior floor finish shall be characterized by a critical radiant flux not less than 0.22 W/cm² but less than 0.45 W/cm².

Since the tested sample received an average Critical radiant flux 1.1 W/cm², it meets the requirements of Class I for interior floor finish specified in NFPA 101-2018 clause 10.2.7.4.

STATEMENTS:

This declaration of conformity is only based on the result of this laboratory activity, the impact of the uncertainty of the results was not included.

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test. They are not intended to be the sole criterion for assessing the potential fire hazard of the product in use. The test results relate only to the specimens of the product in the form in which were tested. Small differences in the composition or thickness of the product may significantly affect the performance during the test and may therefore invalidate the test results. Care should be taken to ensure that any product, which is supplied or used, is fully represented by the specimens, which were tested.

To be continued....



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at hito://www.sac.com/en/Terms-and-Conditions.aspy and, for electronic formal documents as hito://www.sac.com/en/Terms-and-Conditions.aspy and, for electronic Documents at hito://www.sac.com/en/Terms-and-Conditions/Terms-Documents aspection is desired to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document and riverse that information contained hereon reflects the Company's findings at the time of its intermited on other within the limitation of its intermitation contained hereon reflects the Company's Indings at the time of its intermited on within the limits of the company in the property of the company and the propert



No. AJFS2009008017FF

Date: OCT.16, 2020

Page 2 of 4

I. Test conducted

This test was conducted according to ASTM E662-2018 Standard Test Method for Specific Optical Density of Smoke Generated by Solid Materials.

II. Sample details

| Sample description | Carpet Tile | |
|-----------------------|-------------------------------|----|
| Color | One side multi; One side grey | 20 |
| Thickness | About 6.0mm | |
| Dimensions | About 76mm×76mm | |
| Number of test sample | 6 PCS | |
| Exposed surface | The front face | |

III. Test details

Condition prior to testing:

Prior to testing, the submitted sample was dried for 48 h at 60±3°C and then

23±3℃ and RH 50±5% till constant weight

Irradiance Exposure:

2.50+/-0.05 W/cm²

IV. Test results

1) Flaming mode

| | Test Specimen | | Flaming dripping or | A | |
|---|---------------------------|-------|---------------------|-----------------|---------|
| | #1 | #2 | #3 | flaming running | Average |
| Temperature of chamber wall (°C) | 36 | 35 | 36 | | |
| $D_{\!$ | 0.5 | 0 | 0.3 | | 0.3 |
| $D_{\!\scriptscriptstyle{ m S4.0}}$ | 142.9 | 85.6 | 91.7 | | 106.7 |
| D_m | 176.3 | 106.9 | 117.2 | NO - | 133.5 |
| $t_{D_{\!$ | 11.0 | 11.0 | 12.1 | | |
| Dm(corr) | 163.7 | 103.4 | 104.9 | | 124.0 |
| Observations | Color of the smoke: Black | | | | |

To be continued...



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printee overleal, available on request or accessible at http://www.sas.com/en/firms-and-Conditions aspr and, for electronic format documents subject to Terms and Conditions for Electronic Documents at http://www.sas.com/en/ferms-and-Conditions/firms-e-Document.aspr. Attention is drawn to the limitation of its lability, indemnification and jurisdiction is subset defined there. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of client's instructions, it any. The Company's sole responsibility is to its Client and this document cannot be reproduced to the service of the document of the docum

| No. 301, Striight Road, 2 Block, Striight Industry Zone, Anj Courty, Zhejang Photrox, China 3 (3300) | t (86-572) 5(1825 f (86-572) 5(1825) | www.segegroup.com.cn |中国 - 新江 - 安吉县阳光工业园二区阳光大道301号 | 邮第:313300 | t (86-572) 5(1825 f (86-572) 5(1825) | e sgs. china@egs.com



No. AJFS2009008017FF

Date: OCT.16, 2020

Page 3 of 4

2) Non - Flaming mode

| | Test Specimen | | nen | Flaming dripping or | |
|---|---------------------------|-------|-------|---------------------|---------|
| | #1 | #2 | #3 | flaming running | Average |
| Temperature of chamber wall (°C) | 36 | 36 | 36 | | |
| $D_{\!$ | 0 | 0 | 0 | | 0 |
| $D_{\! m S4.0}$ | 28.9 | 30.6 | 31.2 | l No | 30.2 |
| D_m | 441.8 | 467.5 | 456.9 | NO - | 455.4 |
| $t_{D_{\!_{m}}}$ (min) | 17.5 | 16.7 | 16.2 | | |
| Dm(corr) | 441.8 | 467.5 | 456.9 | | 455.4 |
| Observations | Color of the smoke: Black | | | | |

Note:

D_{s1.5} — Specific optical density at 1.5 minutes;

D_{s4.0} — Specific optical density at 4.0 minutes;

D_m — Maximum Specific optical density at any time during the 20 minutes;

t Dm- The time in minutes for the smoke to accumulate to the maximum specific optical density;

D_m(corr) —Dm corrected for incidental deposits on the optical surface

STATEMENTS:

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test. They are not intended to be the sole criterion for assessing the potential fire hazard of the product in use. The test results relate only to the specimens of the product in the form in which were tested. Small differences in the composition or thickness of the product may significantly affect the performance during the test and may therefore invalidate the test results. Care should be taken to ensure that any product, which is supplied or used, is fully represented by the specimens, which were tested.

To be continued...



No. 301, Surlight Road, 2 Block, Surlight Inclustry Zone, Anji County, Zhejiang Province, China 313300 t (65-572) 501825 f (65-572) 5018229 www.sgsgroup.com.cn 中国·浙江·安吉县阳光工业园二区阳光大道301号

邮编:313300 t (85-572) 5018825 f (86-572) 5018829 e sgs.china@sgs.com



Date: 2020-10-12 No.: ST20090229

Page 2 of 4

Test Results:

EN 13501-1:2007+A1:2009 Fire classification of construction products and building elements - Part 1: Classification using data from reaction to fire tests

1. EN ISO 11925-2:2010

Test Results

| Test Method | <u>Parameter</u> | Specimens number | Results |
|--|------------------------|------------------|---------|
| EN ISO 11925-2:2010 | F _S ≤ 150mm | | Yes |
| Surface exposure 15s flame application | Ignition filter paper | 6 | No |
| EN ISO 11925-2:2010 | F _S ≤ 150mm | | Yes |
| Edge exposure 15s flame application | Ignition filter paper | 6 | No |

2. EN ISO 9239-1:2010 Determination of the burning behaviour using a radiant heat source

Test Results

| Test Method | <u>Parameter</u> | Specimens number | Results |
|--------------------|-----------------------|------------------|---------|
| EN ISO 9239-1:2010 | Critical flux (kW/m²) | 4 | 8.2 |

Classification

This classification has been carried out in accordance with EN 13501-1:2007+A1:2009.

Conclusion

According to the test results, the submitted sample (complied) the requirements of EN 13501-1: 2007+A1:2009, class Bn

Remark: The classes with their corresponding fire performance are given in Table 2.

Note: When a statement of conformity to a specification or standard is provided, the ILAC-G8 Guidánce document (and/or IEC Guide 115 in the electrotechnical sector) will be adopted as a decision rule for the determination of conformity unless it is inherent in the requested specification or standard, or otherwise specified in the Report.

STC (Shanghai) Company Limited

. 130 Huashen Road, Walgaoqiao Pilot Free Trade Zone, Shanghai, China. Zip Code: 200131
Tel: +86 21 5219 8248 Fax: +86 21 5219 8249 Email: shstc@stc-group.org Website: www.stc-group.org





Date : 2020-10-12 No. : ST20090229 Page 3 of 4

Table 2 — Classes of reaction to fire performance for floorings

| Class | Test method(s) | Classification criteria | Additional classification |
|-------|----------------------------------|---|---------------------------|
| A1n | EN ISO 1182 ^a | Temperature rise $\Delta T \leq 30$ °C; and | |
| | and | Mass loss $\Delta m \le 50$ %; and | |
| | | Duration of sustained flaming $t_f = 0$ | |
| | EN ISO 1716 | Gross calorific potential PCS ≤ 2.0 MJ/kg ^a and Gross calorific potential PCS ≤ 2.0 MJ/kg ^b and Gross calorific potential PCS ≤ 1.4 MJ/m ² | - |
| | | cand Gross calorific potential PCS ≤ 2.0 MJ/kg | |
| A2 n | EN ISO 1182 a or | Temperature rise $\Delta T \le 50$ °C; and Mass loss $\Delta m \le 50$ %; and Duration of sustained flaming $t_f \le 20$ s | |
| | EN ISO 1716 and | Gross calorific potential PCS ≤ 3.0 MJ/kg ^a and Gross calorific potential PCS ≤ 4.0 MJ/m ² ^b and Gross calorific potential PCS ≤ 4.0 MJ/m ² ^c and Gross calorific potential PCS ≤ 3.0 MJ/kg ^d | . |
| | EN 9239-1° | Critical flux ^f ≥ 8.0 kW/m ² | Smoke production 8 |
| Bn | EN 9239-1° and | Critical flux ^f ≥ 8.0 kW/m ² | Smoke production g |
| | EN ISO 11925-2 Exposure = 15s | Flame spread $F_s \le 150$ mm within 20 s | - |
| Сп | EN 9239-1° and | Critical flux ^f ≥ 4.5 kW/m ² | Smoke production 8 |
| | EN ISO 11925-2 Exposure = 15s | Flame spread $F_s \le 150$ mm within 20 s | • |
| Dn | EN 9239-1° and | Critical flux ^f ≥ 3.0 kW/m ² | Smoke production g |
| | EN ISO 11925-2 Exposure = 15s | Flame spread Fs ≤ 150 mm within 20s | - |
| En | EN ISO 11925-2 Exposure = 15s | Flame spread Fs ≤ 150 mm within 20s | |
| Fo | No performance de | etermined | • |

Note: When a statement of conformity to a specification or standard is provided, the ILAC-G8 Guidance document (and/or IEC Guide 115 in the electrotechnical sector) will be adopted as a decision rule for the determination of conformity unless it is inherent in the requested specification or standard, or otherwise specified in the Report.

STC (Shanghai) Company Limited





SL52035298443001TX

Date:September 22,2020

Page 2 of 2

Test Result


Color Fastness To Crocking

(AATCC TM 165-2013;)

| :- | Unit | Α |
|--------------|------|-----|
| Dry Staining | | 4.5 |
| Wet Staining | - | 4.5 |

Remark: Grey Scale Rating is based on the 5-step scale of 1 to 5, where 1 is worst and 5 is best

Sample Photo

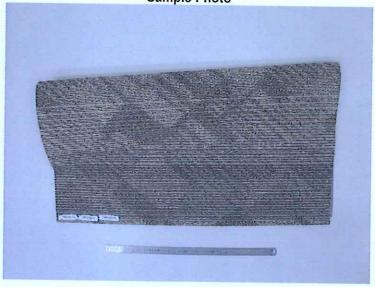

End of Report



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fulliest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-75) 8307 1443, or omail: Ch.Doccheck@sgs.com | Ch.Docc

中国・上海・徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61402666 f (86-21) 64958763 e sgs.china@sgs.com



SL52035298442801TX

Date:September 22,2020

Page 2 of 2

Test Result

Tuft Bind of Pile Yarn Floor Coverings

(ASTM D1335-17E1;)

Tuft Bind(lbf)


No. 1 8.8

No. 2 8.6

No. 3 8.8

No. 4 9.6

No. 5 7.9

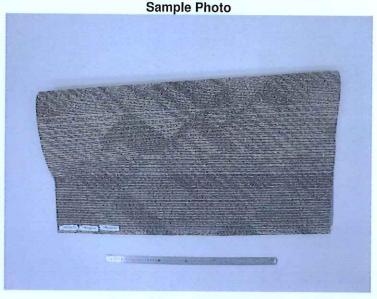

End of Report



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document obes not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fulliest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

3*Biding/NSSS/sharRed/whi/Districts/argic/tins 200233

1 (86-21) 61402888 f (86-21) 64958763

Www.sgsgroup.com.cn

4 SS. CHILLOSSTSS

8 SS. ChillosSTSS

8 SS. ChillosSTSS

8 SS. ChillosSTSS

8 SS. ChillosSTSS

9 SS. ChillosSTSS

9 SS. ChillosSTSS

1 ChillosSTS

中国・上海・徐汇区宜山路889号3号楼 邮编: 200233

t (86-21) 61402666

f (86-21) 64958763

e sgs.china@sgs.com

GREEN LABEL PLUS

INDOOR AIR QUALITY TESTING PROGRAM
THIS CERTIFIES THAT

Address: No.12-1.Jintong road, Tongan Town, High-Tech development Zone, Suzhou City, Jiangsu China

HAS MET THE REQUIREMENTS OF THE CARPET AND RUG INSTITUTE'S GREEN LABEL PLUS PROGRAM FOR CATEGORY:

15X Pre-dyed Nylon with Bitumen Backing

Range of Total VOCs 0.5 mg/m³ or less

Product Type: Modular Tile

Joe W. Yarbrough, President The Carpet and Rug Institue, Inc.

Certification Date: 02/28/2018 Expiration Date: 12/31/2021

To view all GLP-Certified products visit www.carpet-rug.org/glpproducts.

Page 1 of 1





GLP100054

This product complies with California DPH Section 01350 Version 1.2 Private Office Scenario.

A USGBC® recognized third party certification program for LEED v4 EQ Credit Low-Emitting Materials.



ISO/IEC 17065
Product Certification Body
#0754



QUALITY MANAGEMENT SYSTEM CERTIFICATE

Certificate No.: 05507Q10436R1M-1

We hereby certify that

TILE CARPET CO., LTD.

REGISTRATION ADDRESS: NO.4997, BAOAN ROAD, ANTING TOWN, JIADING DISTRICT, SHANGHAL P.R. CHINA

PRODUCTION ADDRESS: NO.12, JINTONG ROAD, TONG'AN TOWN, SUZHOU HIGH-NEW INDUSTRIAL PARK, JIANGSU PROVINCE, P.R. CHINA

POST CODE: 201805

by reason of its

QUALITY MANAGEMENT SYSTEM

has been awarded this certificate for compliance with the standards

GB/T19001-2000 idt ISO9001: 2000

(The 7.3 is excluded)

This system is valid for the following area:

PRODUCTION OF "JUDONG" TILE CARPET (PVC TILE CARPET & MODIFIED BITUMEN TILE CARPET & CUSHION BACK TILE CARPED

Date of Issue: August 28, 2008

Date of Expiry: December 27,2008

Certification Body: China Environmental United (Beijing)

Cornticato Cepter Co., Ltd.

Body Address: No.1, Yuhui Cor Road, Class and District, Beijing, China

Issued by:

The enjoy of this certification will be to one year later since the valid date issued od be re-valid just with the security feature of annual surveillance together.


The Third







ecurity Features of Annual Surveillance





ISO14001 CERTIFICATE

Certificate No.: 05506E10205R1M

We hereby certify that

TILE CARPET CO., LTD.

REGISTERED ADDRESS: NO.4997, BAOAN ROAD, JIADING DISTRICT, SHANGHAL PR. CHINA PRODUCTION ADDRESS: NO.12, JINTONG ROAD, TONGAN TOWN, NEW INDUSTRIAL PARK, SUZHOU, PR. CHINA

POST CODE: 201805

by reason of its

Environmental Management System

has been awarded this certificate for compliance with the standards

GB/T24001:2004 idt ISO14001: 2004

The Environmental Management System applies in the following area:

THE RELEVANT SITES OF SHANGHAL JUDONG THE CARPET CO., LTD., LOCATED AT NO.4997, BAOAN ROAD, JIADING DISTRICT, SHANGHAI/ NO.12, JINTONG ROAD, TONGAN TOWN, NEW INDUSTRIAL PARK, SUZHOU, P.R. CHINA, AND THE WHOLE PROCESS OF PRODUCTION OF PVC TILE CAR<u>PET AND MODIFIED MATERIAL TILE CARPET</u>

Date of Issue: July 31, 2008

Date of Expiry: September 13. 2060 >

Certification Body: China Environmental Chice (Bring)

Certification Coter Co., 1 to

Body Address: No. I. Yuhui South Road, Charryang District, Berjing, China

Issued by:

The energy of this certification will be to one year later since the voild date issued. and be re-valid just with the security feature of annual surveillance together.

Die Second

Tise Third







Socurity Features of Arroad Surveiturce

